

220-240V / 50-60Hz  
IP66



## Terminal Labelling:

### Power

L1 Switched Live  
E Earth  
N Neutral

### Emergency


L2 Unswitched Live  
DA/AT3 DALI Autotest  
DA/AT3 DALI Autotest

### Dimming

-D1/DA Analogue/DSI/DALI  
+D2/DA Analogue/DSI/DALI  
L3 Switch Dim / Corridor Function


**WARNING:** Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source is non replaceable. **LUMINAIRES WITH EMERGENCY PACK:** When supply is isolated battery output terminals may be live if battery is connected. Isolate mains and battery before servicing. Emergency luminaires require unswitched live connection taken from same phase as switched supply. When unswitched supply is connected status indicator illuminates green, when unswitched supply is disconnected indicator extinguishes and luminaire operates in emergency mode. 24 hour charge period required before undertaking full discharge test. Emergency test sheets provided should be used to record all emergency tests. Batteries should be replaced when 3 hour duration is not met. Excessive switching of permanent live may result in premature battery failure. Battery electrolyte can be harmful to eyes / open wounds, do not puncture, if electrolyte touches skin / eyes flush with water. Do not incinerate batteries.

1.

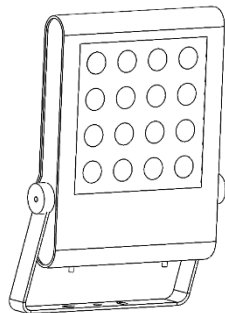


Fitting will come complete ready to install.

2.

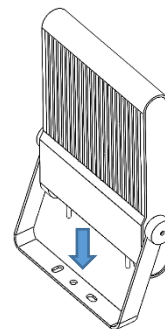


Screw the mounting bracket to the surface in the desired location.

3.




To adjust angle of the fitting, relax the 2 screws using an allen key.

4.

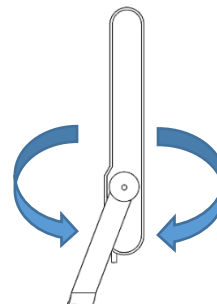

Tilt fitting to the desired angle, then tighten the screws in (step 3) to fix in place.

5.

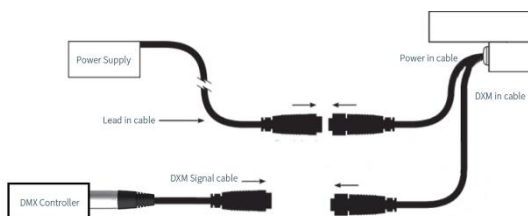

Wire the fitting to the power supply and DMX controller using the 2 cables provided.

6.