## **Protec Display Installation**



## 220-240V / 50-60Hz IP20

Terminal Labelling: Power

Power L1 E (

Switched Live Earth Neutral


L2 DA/AT3 DA/AT3 **Dimming** -/D1/DA +/D2/DA L3 Unswitched Live DALI Autotest DALI Autotest


Analogue/DSI/DALI Analogue/DSI/DALI Switch Dim / Corridor Function






WARNING: Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source contained in this light source shall only be replaced by the manufacturer or his service agent or a similar qualified person. LUMINAIRES WITH EMERGENCY PACK: When supply is isolated battery output terminals may be live if battery is connected. Isolate mains and battery before servicing. Emergency luminaires require unswitched live connection taken from same phase as switched supply. When unswitched supply is connected status indicator illuminates green, when unswitched supply is disconnected indicator extinguishes and luminaire operates in emergency mode. 24 hour charge period required before undertaking full discharge test. Emergency test sheets provided should be used to record all emergency tests. Batteries should be replaced when 3 hour duration is not met. Excessive switching of permanent live may result in premature battery failure. Battery electrolyte can be harmful to eyes / open wounds, do not puncture, if electrolyte touches skin / eyes flush with water. Do not incinerate batteries.

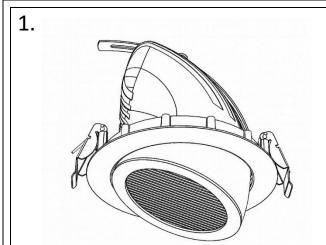

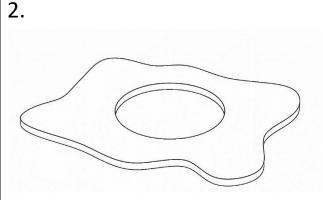

Aperture to be 174mm


3.



 $Check\ tension-tighten\ if\ necessary!$ 

4.

6.

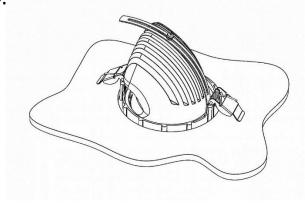

Standard (new) installation

5.



For installation into existing aperture greater than 174 (up to 220mm), use adapter ring kit.

Tilt / rotate luminaire as required

## **Protec Display Installation**



## Maintenance 1 Disconnect luminaire before undertaking LED Circuit any maintenance or cleaning Cleaning should be undertaken on external parts of the luminaire only Driver using a slightly damp lint free cloth. Use a flat head screwdriver to remove diffuser from fitting. Use a pan pozi screwdriver to remove LED circuit. Driver is maintainable. Endcaps are 5 removable. Please contact Dextra for assistance with spare component supply.

DIL-63-0002 Revision - I 19/10/2023