


Avalon Wallpack LED IP65 Floodlight

230-240V / 50-60Hz

IP65

IK**



WARNING - THIS LUMINAIRE MUST BE EARTHED


This luminaire has been tested and is manufactured to comply with BS EN 60598 : specification for general requirements and tests. It should be installed by a suitably qualified person in accordance with IEE.

CAUTION: there is a potential risk of electric shock from the LED boards when the product is operational with the cover removed.

NOTE: INSTALLATION AND OPERATION OF THE LUMINAIRE BEYOND ITS SCOPE OF SUPPLY WILL INVALIDATE THE WARRANTY.

DIL-59-0004

1.

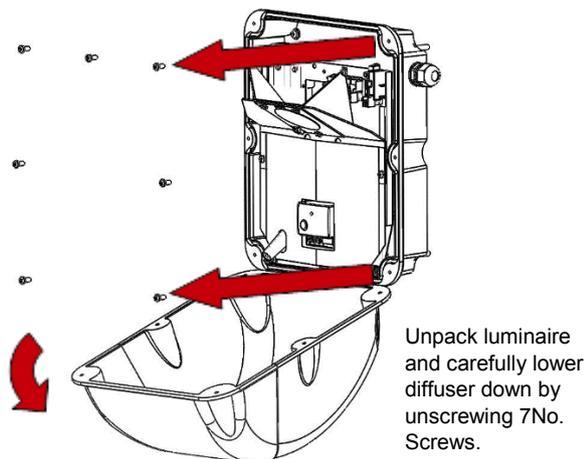


Unpack luminaire and carefully lower diffuser down by unscrewing 7No. Screws.

2.


Remove gear tray by unscrewing 2No. M4x5 screws and 1No. M5x6 screw.

Lower tray gently on its tethers.

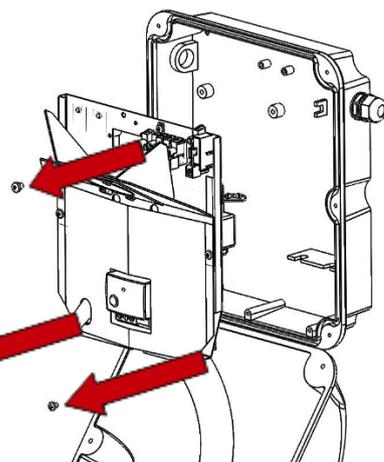


3.

Secure base to wall through 4No. Holes. Washers to be used with screws (not supplied) to maintain IP rating. Any unused holes **MUST** be filled to retain IP65 rating.

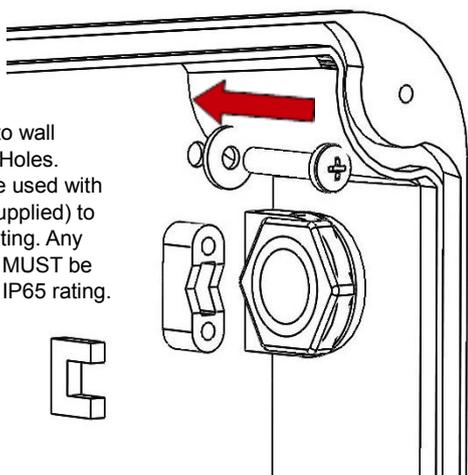


4.

Feed mains supply through most appropriate cable entry side using IP65 rated gland. Where photocell is fitted, cable entry restricted to right hand side. When photocell is not fitted, use supplied bung to fill unused cable entry hole.

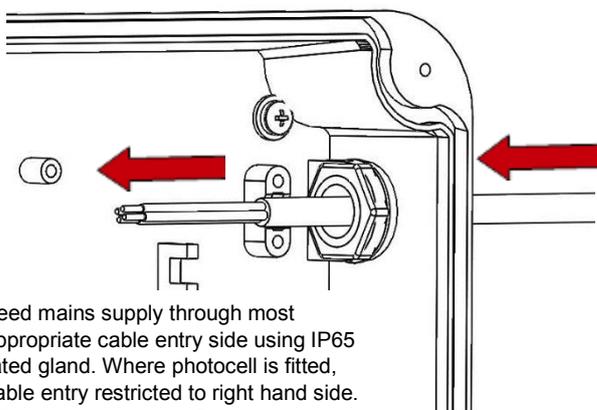

5.

Wire mains cable into relative terminals. All terminals are marked.

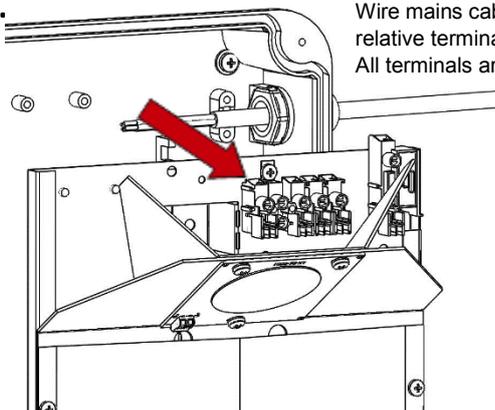

6.

Reattach gear tray ensuring M5x6 screw is fed through earth lead. Attach diffuser using 7No. M4x8 screws ensuring washers are retained.

